


STANDARD DETAIL DRAWINGS

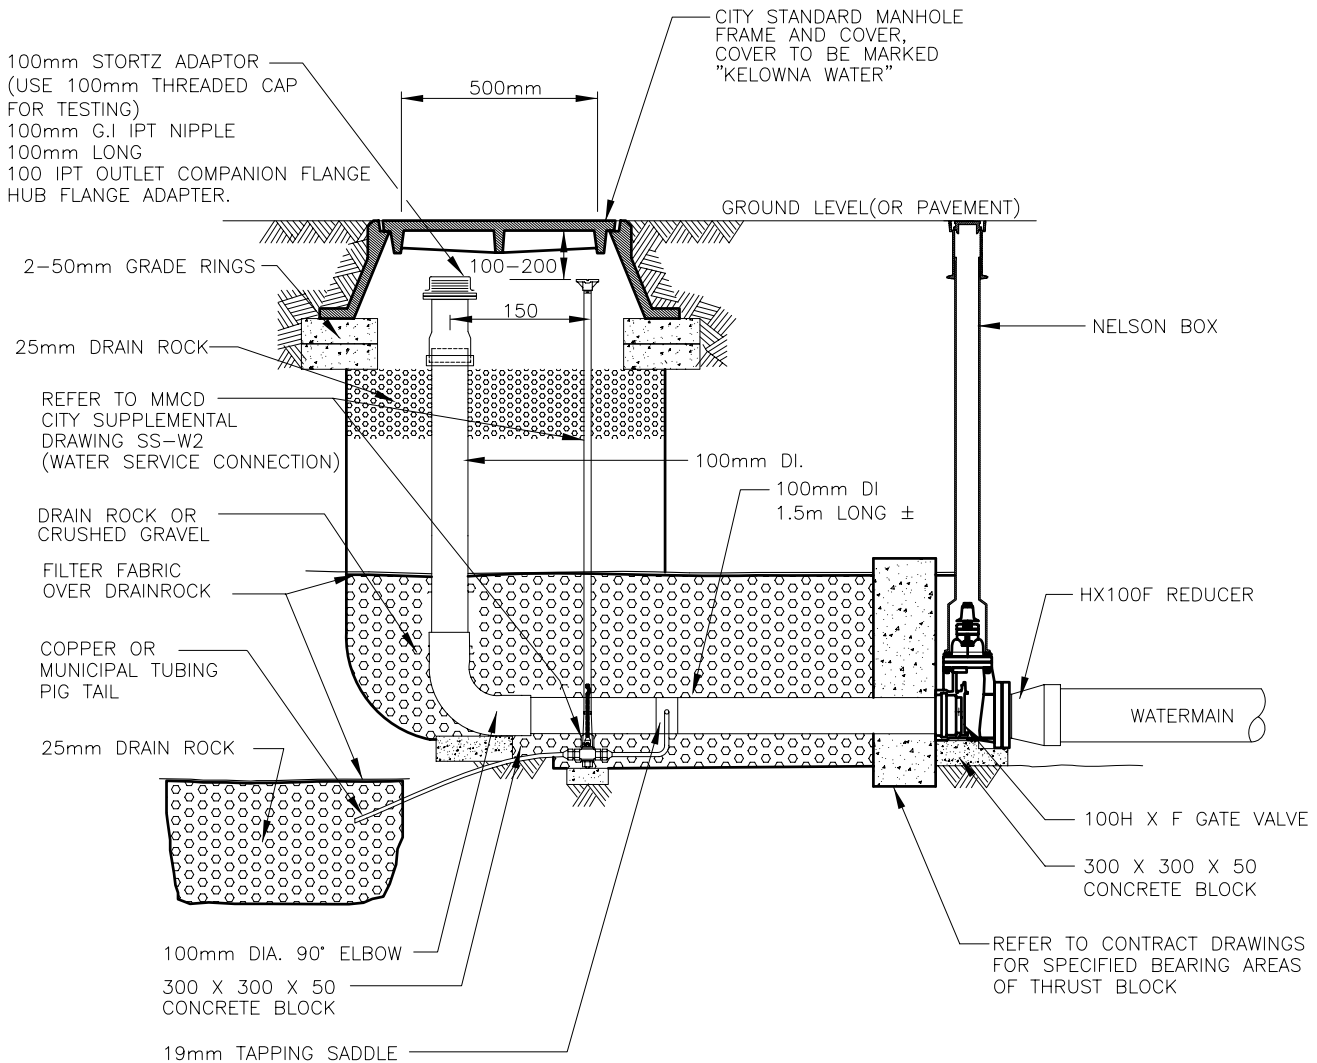

NOTES:

1. USE JOINT RESTRAINTS FOR ALL JOINTS.
2. ALL JOINT RESTRAINTERS TO BE APPROVED AS PER POLICY 266 IN THE CITY OF KELOWNA SUBDIVISION AND SERVICING BYLAW.
3. ALL JOINTS TO BE RESTRAINED AS PER MMCD 02666, 2.2.13 AND THE CITY OF KELOWNA SUBDIVISION AND SERVICING BYLAW SCHEDULE 4 WATER, SECTION 1.13, AND/OR AS SPECIFIED IN THE CONTRACT DOCUMENTS OR DRAWINGS.
4. ENTIRE ASSEMBLY TO BE PRESSURE TESTED.
5. FOR ALL BOLTS AND JOINT RESTRAINTERS, USE DENSO PASTE AND TAPE.
6. PVC C900 PIPE MAYBE APPROVED BY UTILITIES OTHER THAN THE CITY

100mm BLOW-OFF
(FOR MAINS 150mm & LARGER)

APRIL 15/08

SS-W8b